


THE CLEAR POLYCARBONATE PANELS APPROVED
IN THIS DOCUMENT MAY BE INTEGRATED WITH
ALTERNATE STEEL/ALUMINUM PANEL
APPROVALS PROVIDED THE MINIMUM
INSTALLATION CONDITIONS OUTLINED HEREIN
ARE NOT EXCEEDED



MINIMUM POLYCARBONATE PANEL PROPERTIES FOR USE WITH THIS APPROVAL		
SPECIFIC GRAVITY	1.20 G/CC	ASTM D792
TENSILE YIELD STRENGTH	8700 PSI	ASTM D638
FLEXURAL STRENGTH AT YIELD	12500 PSI	ASTM D790
FLEXURAL MODULUS	340000 PSI	ASTM D790
NOTCHED IZOD	18 FT-LB/IN	ASTM D256
SMOKE DENSITY	75 MAX	ASTM D2843
RATE OF BURNING	C-1 CLASS MAX	ASTM D635
SELF IGNITION	650 DEG. F	ASTM D1929


AS NOTED IN DESIGN
SCHEDULES

POSITIVE & NEGATIVE (ASD) DESIGN PRESSURES FOR USE WITH THIS SYSTEM SHALL BE DETERMINED ON A SITE-SPECIFIC BASIS AND COMPARED TO LIMITING FACTORS AS STIPULATED HEREIN. THEY SHALL BE CALCULATED IN ACCORDANCE WITH THE GOVERNING CODE REQUIREMENTS & IN ACCORDANCE WITH ASCE 7-10 AND CHAPTER 1609 OF THE FLORIDA BUILDING CODE. THEY SHALL BE LESS THAN OR EQUAL TO THE POSITIVE OR NEGATIVE DESIGN PRESSURE CAPACITY VALUES LISTED HEREIN FOR ANY ASSEMBLY AS SHOWN.

TOP & BOTTOM DETAILS SHOWN MAY BE INTERCHANGED AS FIELD CONDITIONS DICTATE. PANELS MAY BE MOUNTED VERTICALLY OR HORIZONTALLY AS APPLICABLE.

1. THIS SPECIFICATION HAS BEEN DESIGNED AND SHALL BE FABRICATED IN ACCORDANCE WITH THE REQUIREMENTS OF THE FLORIDA BUILDING CODE SIXTH EDITION (2017) FOR USE INSIDE AND OUTSIDE OF THE HVHZ, PER TAS 201, 202 & 203 AND ASTM E330, E1886 & E1996 TEST PROTOCOLS.
2. THE CONTRACTOR SHALL INVESTIGATE AND REPORT TO ALL LOCAL BUILDING CODE AGENCIES WHICH MAY APPLY. DESIGN CRITERIA BEYOND AS STATED HEREIN MAY REQUIRE ADDITIONAL SITE-SPECIFIC SEALED ENGINEERING.
3. NO 33-1/3% INCREASE IN ALLOWABLE STRESS HAS BEEN USED IN THE DESIGN OF THIS SYSTEM.
4. THE ARCHITECT/ENGINEER OF RECORD FOR THE PROJECT SUPERSTRUCTURE WITH WHICH THIS DESIGN IS USED SHALL BE RESPONSIBLE FOR THE INTEGRITY OF ALL SUPPORTING SURFACES TO THIS DESIGN WHICH SHALL BE VERIFIED AND APPROVED BY THE CONTRACTOR.
5. SEPARATE "SITE-SPECIFIC" SIGNED AND SEALED ENGINEERING SHALL BE REQUIRED IN ORDER TO DEVIATE, INTERPOLATE, AND EXTRAPOLATE FROM THE CODES, DEFLECTIONS, AND SPANS CONTAINED HEREIN. CONTINGENT ON THIS ENGINEER'S DESIGN, THE CONTRACTOR SHALL BE REQUIRED TO PROVIDE REFERENCE HEREIN FOR ALTERNATE SPAN CALCULATIONS AS MAY BE REQUIRED.
6. THE SYSTEM DETAILED HEREIN IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR ANY SPECIFIC SITE. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILERED HEREIN, THE CONTRACTOR'S REGISTERED ARCHITECT SHALL PREPARE SITE SPECIFIC DOCUMENTS FOR USE IN CONJUNCTION WITH THIS DOCUMENT.
7. THE CONTRACTOR'S NUMERICAL DESIGNATIONS ARE BASED ON MAXIMUM TESTED PRESSURES DIVIDED BY A 1.5 SAFETY FACTOR.
8. ALL FASTENERS TO BE 1/2" OR GREATER SEA GRADE 5 UNLESS NOTED OTHERWISE. FASTENERS SHALL BE CADMIUM-PLATED OR OTHERWISE CORROSION RESISTANT TO MEET THE CORROSION RESISTANCE SPECIFICATIONS FOR ALUMINUM STRUCTURES- SECTION 3.7.7.2 BY THE ALUMINUM ASSOCIATION, INC., & ANY APPLICABLE FEDERAL, STATE, AND/OR LOCAL CODES.
9. ALL STORM PANELS SHALL BE CLEAR POLYCARBONATE, $t=0.100"$ AND CONFORM TO THE SPECIFICATIONS LISTED HEREIN.
10. ALL ALUMINUM EXTRUSIONS SHALL BE 6063-T6 ALUMINUM ALLOY OR BETTER, UNLESS NOTED OTHERWISE.
11. ALL ANCHORS AND FASTENERS HEREIN SHALL BE EMBEDDED TO NON-CRACKED CONCRETE ONLY. INSTALL ALL CONCRETE ANCHORS PER MANUFACTURER'S RECOMMENDATIONS.
12. THE CONTRACTOR IS RESPONSIBLE TO INSULATE OR PROTECT ALL MEMBERS FROM DISSEMILAR ENVIRONMENTAL EFFECTS TO ANALYSIS.
13. ENGINEER SEAL AFFIXED HERE TO VALIDATES STRUCTURAL DESIGN AS SHOWN ONLY. USE OF THIS SPECIFICATION BY CONTRACTOR, ET AL. INDENIFIES & SAVES HARMLESS THIS ENGINEER FOR ALL COST & DAMAGES IN CONNECTION WITH THE DESIGN, CONSTRUCTION, AND/OR MAINTENANCE, FABRICATION, SYSTEM ERECTION, & CONSTRUCTION PRACTICES BEYOND THAT WHICH IS CALLED FOR BY LOCAL, STATE, & FEDERAL CODES & FROM DEVIATIONS OF THIS PLAN.
14. EXCEPT AS EXPRESSLY PROVIDED HEREIN, NO ADDITIONAL CERTIFICATIONS OR AFFIRMATIONS ARE INTENDED.
15. ALTERATIONS, ADDITIONS, OR OTHER MARKINGS TO THIS DOCUMENT ARE NOT PERMITTED AND INVALIDATE THIS CERTIFICATION.
16. THIS SHALL BE PERMITTED WITH A MINIMUM OF (1) LABEL PER PANEL, CONTAINING THE FOLLOWING INFORMATION:

EASTERN METAL SUPPLY, INC.
WEST PALM BEACH, FL
TAS 201, TAS 202 & TAS 203
ASTM E330, ASTM E1886 & ASTM E1996
FLORIDA PRODUCT APPROVAL NUMBER

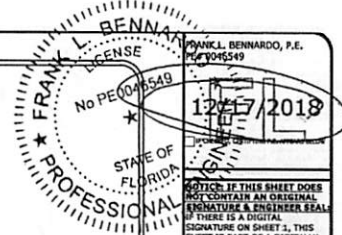

NOTE: IF THIS SHEET DOES NOT CONTAIN AN ORIGINAL SIGNATURE & ENGINEER SEAL, IF THERE IS A DIGITAL SIGNATURE ON SHEET 1, THIS SHEET IS PART OF A DIGITALLY SIGNED FILE, SHALL REMAIN IN DIGITAL FORMAT, & PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED. IF THERE IS NO DIGITAL SIGNATURE ON SHEET 1 OR THIS SHEET DOES NOT CONTAIN AN ENGINEER'S ORIGINAL SIGNATURE & SEAL, THIS SHEET IS A COPY/DRAFT.

EXPRESS®
ENGINEERING

CORPORATE OFFICE:
160 SW 12th AVE, SUITE 106
DEERFIELD BEACH, FL 33442
P: (954) 354-0660, F: (954) 354-0443
E: HELLO@ENGINEERINGEXPRESS.COM
ENGINEERINGEXPRESS.COM
CERT OF AUTH #9885

EASTERN METAL SUPPLY
4268 WESTROADS DR
WEST PALM BEACH, FL
(800) 432-2204

2" CLEAR BERTHA STORM PANEL
FLORIDA BUILDING CODE
FLORIDA STATEWIDE APPROVAL FL283

REMARKS	DRWN	CHKD	DATE
PART ISSUE	RWN	FLB	09/27/18
	*	*	*
	*	*	*
	*	*	*
	*	*	*


THIS DOCUMENT IS THE PROPERTY OF ENGINEERING EXPRESS, AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN CONSENT OF ENGINEERING EXPRESS. A REVISION, ADDITION, OR OTHER MARKINGS TO THE DOCUMENT ARE NOT PERMITTED AND INVALIDATE OUR CERTIFICATION.

COPYRIGHT ENGINEERING EXPRESS®
18-6492

SCALE: NTS UNLESS NOTED

1

12/17/2018 2:23pm ncn V:\Projects\18-6492 Clear Bertha Storm Panels\18-6492_Cover FL28390 1.dwg

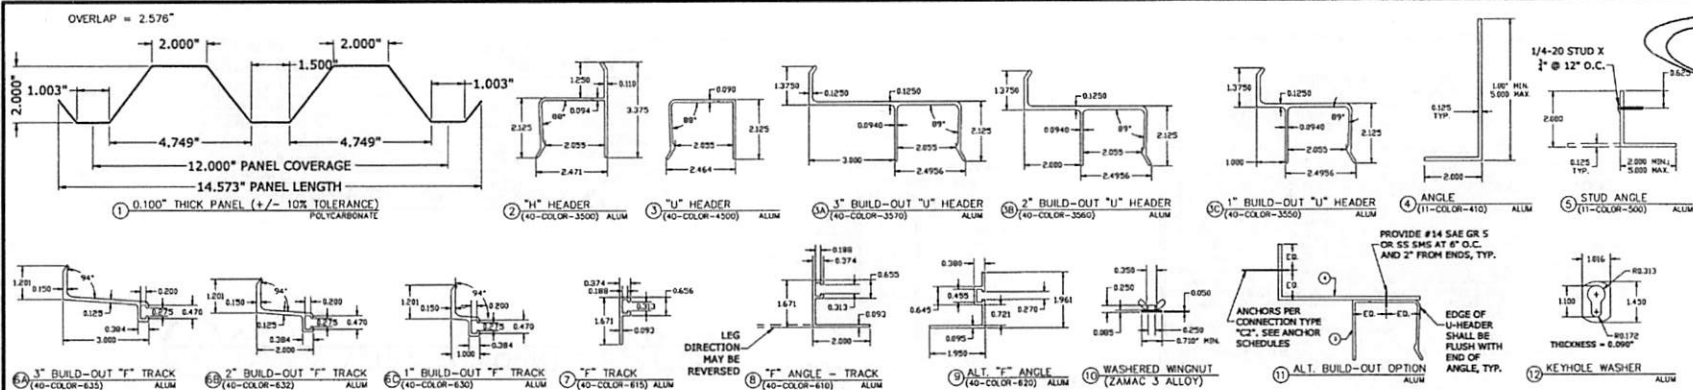

**SCHEDULE 1:
ALLOWABLE PANEL
SPANS (HVHZ &
NON-HVHZ)**
2" CLEAR PANELS

MINIMUM STORM PANEL SEPARATION FROM GLASS (HVHZ, WIND ZONE 4 & ESSENTIAL FACILITIES)			
MAXIMUM DESIGN PRESSURE (PSF)	ALLOWABLE SPAN (Lmax)	INSTALLATIONS LESS THAN 30' ABOVE GRADE	INSTALLATIONS GREATER THAN 30' ABOVE GRADE
+/-21	132.0 in	10.50 in	9.75 in
+/-26	120.0 in	10.00 in	9.25 in
+/-31	108.5 in	9.50 in	8.50 in
+/-36	96.5 in	9.00 in	8.00 in
+/-41	84.5 in	8.50 in	7.25 in
+/-46	73.0 in	8.00 in	6.75 in
+/-51	61.0 in	7.50 in	6.00 in
+/-56	49.5 in	7.00 in	5.25 in
+/-60	40.0 in	6.50 in	4.75 in

- SEE SHEET 4 FOR ANCHORAGE OPTIONS

**SCHEDULE 2: ALLOWABLE PANEL
SPANS (NON-HVHZ ONLY)**
2" CLEAR PANELS

MINIMUM STORM PANEL SEPARATION FROM GLASS (WIND ZONE 4 & ESSENTIAL FACILITIES)			
MAXIMUM DESIGN PRESSURE (PSF)	ALLOWABLE SPAN (Lmax)	INSTALLATIONS LESS THAN 30' ABOVE GRADE	INSTALLATIONS GREATER THAN 30' ABOVE GRADE
+/-35	144.0 in	10.25 in	7.00 in
+/-40	133.0 in	9.75 in	6.25 in
+/-45	122.0 in	9.50 in	5.50 in
+/-50	111.0 in	9.00 in	4.75 in
+/-55	100.0 in	8.50 in	4.00 in
+/-60	89.0 in	8.00 in	3.00 in




- SEE SHEET 5 FOR ANCHORAGE OPTIONS
- SPANS AND SEP. FROM GLASS LISTED IN THIS TABLE ARE ONLY APPLICABLE FOR CONNECTION TYPES C1 AND C2 ONLY.
- "H" HEADER, "U" HEADER AND "C3" CONNECTION OPTIONS SHALL NOT BE USED WITH THIS TABLE
- MINIMUM PANEL SPAN IS 36.0". UTILIZE GLASS SEPARATION FOR 89" SPAN TIER FOR SPANS LESS THAN SHOWN IN TABLE

SPAN SCHEDULE NOTES:

1. ENTER SPAN SCHEDULES WITH NEGATIVE DESIGN LOAD & PANEL FASTENER SPACING TO DETERMINE MAXIMUM ALLOWABLE STORM PANEL SPAN. SCHEDULE IS ACCEPTABLE FOR USE WITH POSITIVE LOADS LESS THAN OR EQUAL TO NEGATIVE DESIGN LOADS.
2. LINEAR INTERPOLATION BETWEEN LOADS IS ACCEPTABLE, OTHERWISE USE NEXT HIGHER LOAD.

GLASS SEPARATION NOTES:

1. ENTER SPAN SCHEDULE WITH POSITIVE DESIGN LOAD TO DETERMINE MINIMUM ALLOWABLE SEPARATION FROM THE OPENING TO BE PROTECTED.
2. SCHEDULE IS REQUIRED FOR USE WITH POSITIVE LOADS ONLY. INTERPOLATION BETWEEN LOADS IS ACCEPTABLE, OTHERWISE USE NEXT HIGHER LOAD.
3. FOR INSTALLATIONS OUTSIDE OF THE HVHZ AND OUTSIDE OF ESSENTIAL FACILITIES IN ASTM WIND ZONES 1 THROUGH 3, THE GLASS SEPARATION SCHEDULE IS NOT REQUIRED AND NO MINIMUM SEPARATION FROM THE PROTECTED OPENING IS REQUIRED.

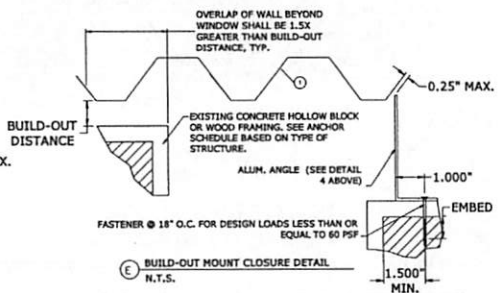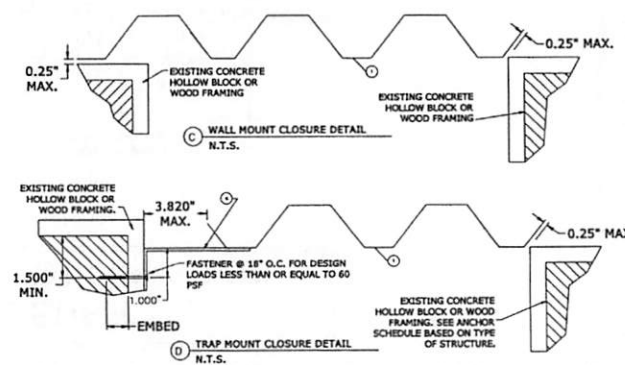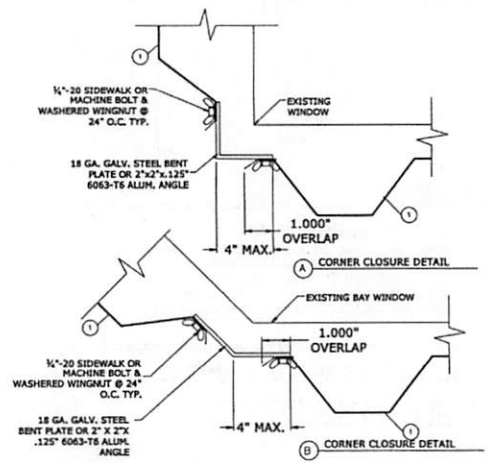

FRANK J. BENARDO
LICENSE NO. 12717
STATE OF FLORIDA
PROFESSIONAL ENGINEER

NOTICE: IF YOU SIGN THIS SHEET, YOU ARE CERTIFYING THAT YOU ARE A LICENSED PROFESSIONAL ENGINEER IN THE STATE OF FLORIDA AND THAT THIS SHEET IS PART OF A DIGITALLY SIGNED FILE. SHALL REMAIN IN DIGITAL FORMAT, A PRINTED COPY OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED. IF THERE IS NO DIGITAL SIGNATURE ON SHEET 1 OR THIS SHEET DOES NOT CONTAIN AN ENGINEER'S ORIGINAL SIGNATURE AND SEAL, THIS SHEET IS A COPY/DRAFT.

ENGINEERING EXPRESS®
CORPORATE OFFICE:
160 SW 12th AVE, SUITE 106
DEERFIELD BEACH, FL 33442
P: (561) 394-5460 F: (561) 394-5443
E: INFO@ENGINEERINGEXPRESS.COM
ENGINEERINGEXPRESS.COM
CERT. OF AUTH. #9885

EASTERN METAL SUPPLY
4268 WEST PALM BEACH, FL
WEST PALM BEACH, FL
(800) 432-2204

2" CLEAR BERTHA STORM PANEL
FLORIDA BUILDING CODE
FLORIDA STATEWIDE APPROVAL FL28390.1

DATE	BY	CHKD	APP
08/27/18	FLB		

REMARKS: THIS DOCUMENT IS THE PROPERTY OF ENGINEERING EXPRESS AND SHALL NOT BE REPRODUCED IN WHOLE OR PART WITHOUT WRITTEN PERMISSION. ANY REUSE, MODIFICATION, OR OTHER VIOLATION OF THIS DOCUMENT ARE NOT PERMITTED AND WILL BE SUBJECT TO LITIGATION.







COPYRIGHT ENGINEERING EXPRESS®

18-6492

SCALE: NTS UNLESS NOTED

2

PANEL CONNECTION OPTIONS

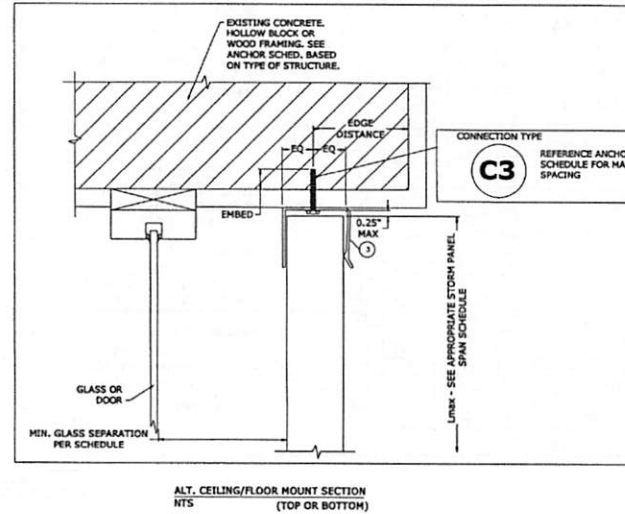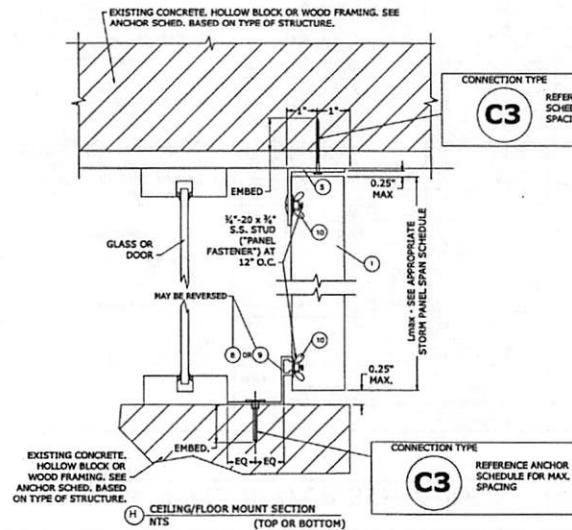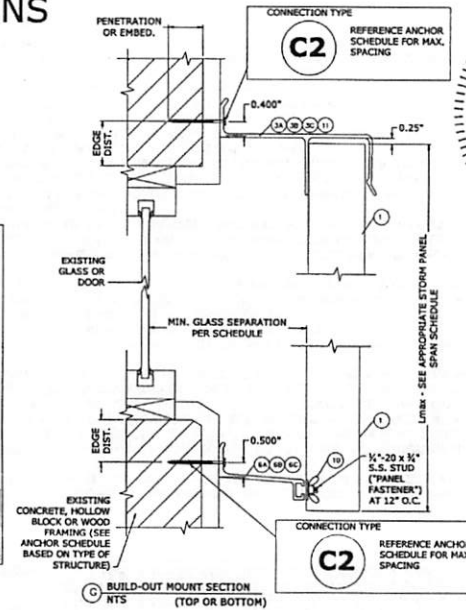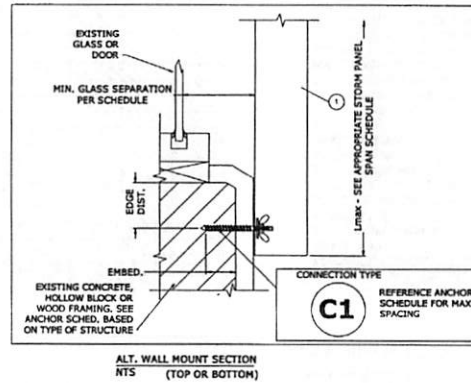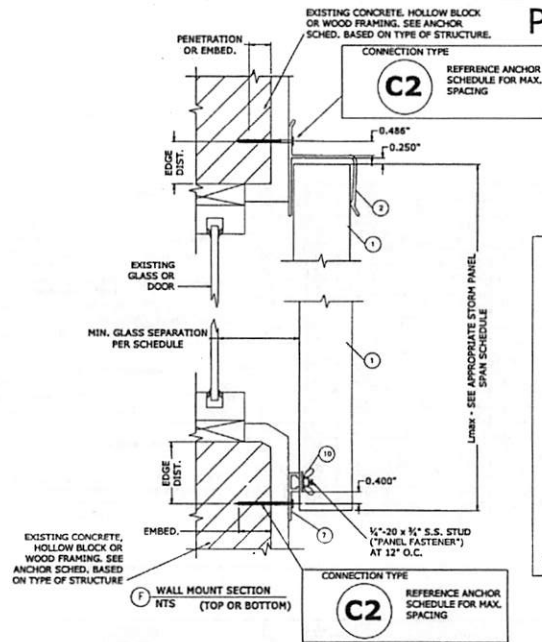

NOTICE: IF THIS SHEET DOES NOT CONTAIN AN ORIGINAL SIGNATURE, ENGINEER SEAL, OR DIGITAL SIGNATURE, THIS SHEET IS NOT VALID. IF THIS SHEET IS A COPY, IT SHALL REMAIN IN ORIGINAL FORMAT, AND PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED. IF THERE IS NO DIGITAL SIGNATURE ON SHEET 1 OR THIS SHEET DOES NOT CONTAIN AN ENGINEER'S ORIGINAL SIGNATURE & SEAL, THIS SHEET IS A COPY/REPRINT.

ENGINEERING EXPRESS
CORPORATE OFFICE
160 SW 12th AVE, SUITE 108
DEERFIELD BEACH, FL 33442
P: (561) 334-0669 F: (561) 334-0643
E: INFO@ENGINEERINGEXPRESS.COM
CERT OF AUTH #9885

EASTERN METAL SUPPLY
4268 WESTROADS DR
WEST PALM BEACH, FL
(800) 432-2204
2" CLEAR BERTHA STORM PANEL
FLORIDA STATEWIDE APPROVAL FL28390-4

REV	DATE	DESCRIPTION
1	09/27/18	ISSUE
2		
3		
4		
5		
6		
7		
8		
9		
10		

REMARKS: THIS DOCUMENT IS THE PROPERTY OF ENGINEERING EXPRESS. IT IS TO BE USED ONLY FOR THE PROJECT AND SITE SPECIFICALLY IDENTIFIED HEREIN. IT IS NOT TO BE REPRODUCED IN WHOLE OR PART WITHOUT THE WRITTEN PERMISSION OF ENGINEERING EXPRESS. ANY REUSE, MODIFICATION, OR OTHER VIOLATION OF THESE TERMS WILL BE PROSECUTED AND PENALIZED FOR VIOLATION.

COMPANY: ENGINEERING EXPRESS
18-6492
SCALE: NTS UNLESS NOTED
3

ANCHOR SPACING (FOR SCHEDULE 1 - HVHZ & NON-HVHZ):

2" CLEAR PANELS


HOST STRUCT.	ANCHOR	LOAD (psf)	EDGE DISTANCES AS NOTED								
			Series Up To 3'-4" (40")			Series Up To 7'-0" (84")			Series Up To 11'-0" (132")		
			CONNECTION TYPE	C1	C2	C3	CONNECTION TYPE	C1	C2	C3	CONNECTION TYPE
CONCRETE	1/4" ITW TAPCON WITH 1-3/4" EMBED AND 1-1/2" MIN. EDGE DISTANCE (3192 psi MIN CONCRETE)	21	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		31	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		41	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		51	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		60	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		60	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
	1/4" ELCO ULTRACON WITH 1-3/4" EMBED AND 1" MIN. EDGE DISTANCE (2846 psi MIN CONCRETE)	21	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		31	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		41	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		51	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		60	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		60	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
	1/4" ELCO PANELMATE (FEMALE, MALE, or PLUS) W/ 1" EMBED AND 2-1/2" MIN. EDGE DISTANCE (3350 psi MIN CONG.)	21	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		31	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		41	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		51	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		60	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		60	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
	1/4" ITW TAPCON STORM GAURD W/ 1-3/4" EMBED AND 1-1/4" MIN. EDGE DISTANCE (3295 psi MIN CONCRETE)	21	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		31	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		41	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		51	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		60	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		60	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
	1/4"-20 ALL POINTS SOLID- SET WITH 7/8" EMBED AND 1-1/4" MIN. EDGE DISTANCE (3000 psi MIN CONCRETE)	21	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		31	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		41	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		51	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		60	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		60	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	

HOST STRUCT.	ANCHOR	LOAD (psf)	EDGE DISTANCES AS NOTED								
			Series Up To 3'-4" (40")			Series Up To 7'-0" (84")			Series Up To 11'-0" (132")		
			CONNECTION TYPE	C1	C2	C3	CONNECTION TYPE	C1	C2	C3	CONNECTION TYPE
HOLLOW (OR GROUT-FILLED) BLOCK	1/4" ITW TAPCON WITH 1" EMBED AND 2" MIN. EDGE DISTANCE (1900 psi MIN CMU)	21	12.0"	12.0"	12.0"	12.0"	12.0"	11.0"	12.0"	12.0"	7.0"
		31	12.0"	12.0"	12.0"	12.0"	12.0"	7.5"			
		41	12.0"	12.0"	12.0"	6.0"	9.5"	5.5"			
		51	12.0"	12.0"	9.5"						
		60	12.0"	12.0"	8.0"						
		60	12.0"	12.0"	8.0"						
	1/4" ELCO ULTRACON WITH 1-1/4" EMBED AND 1" MIN. EDGE DISTANCE (1900 psi MIN CMU)	21	12.0"	12.0"	12.0"	12.0"	12.0"	11.0"	12.0"	12.0"	7.0"
		31	12.0"	12.0"	12.0"	12.0"	12.0"	7.5"			
		41	12.0"	12.0"	12.0"	6.0"	11.5"	5.5"			
		51	12.0"	12.0"	9.5"						
		60	12.0"	12.0"	8.0"						
		60	12.0"	12.0"	8.0"						
	1/4" ELCO PANELMATE (FEMALE, MALE, or PLUS) W/ 1-1/4" EMBED AND 2" MIN. EDGE DISTANCE (2000 psi MIN CMU)	21	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	11.0"
		31	12.0"	12.0"	12.0"	12.0"	12.0"	11.5"			
		41	12.0"	12.0"	12.0"	12.0"	12.0"	9.0"			
		51	12.0"	12.0"	12.0"						
		60	12.0"	12.0"	12.0"						
		60	12.0"	12.0"	12.0"						
	1/4"-20 ALL POINTS SOLID- SET WITH 7/8" EMBED AND 1-1/4" MIN. EDGE DISTANCE (1800 psi MIN CMU)	21	12.0"	12.0"	12.0"	12.0"	12.0"	11.5"	12.0"	12.0"	7.0"
		31	12.0"	12.0"	12.0"	12.0"	12.0"	7.5"			
		41	12.0"	12.0"	12.0"	12.0"	12.0"	5.5"			
		51	12.0"	12.0"	9.5"						
		60	12.0"	12.0"	8.0"						
		60	12.0"	12.0"	8.0"						

HOST STRUCT.	ANCHOR	LOAD (psf)	EDGE DISTANCES AS NOTED								
			Series Up To 3'-4" (40")			Series Up To 7'-0" (84")			Series Up To 11'-0" (132")		
			CONNECTION TYPE	C1	C2	C3	CONNECTION TYPE	C1	C2	C3	CONNECTION TYPE
WOOD	1/4" ITW TAPCON WITH 1-3/8" THREAD PEN. AND 3/4" MIN. EDGE DISTANCE (G=0.42 MIN)	21	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	10.0"
		31	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		41	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		51	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		60	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		60	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
	1/4" ELCO ULTRACON WITH 1-3/8" THREAD PEN. AND 3/4" MIN. EDGE DISTANCE (G=0.42 MIN)	21	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	10.0"
		31	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		41	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		51	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		60	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		60	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
	1/4" ELCO PANELMATE (FEMALE, MALE, or PLUS) W/ 1-7/8" EMBED AND 3/4" MIN. EDGE DISTANCE (G=0.54 MIN.)	21	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		31	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		41	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		51	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		60	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		60	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
	1/4" ITW TAPCON STORM GAURD W/ 1-3/4" EMBED AND 1-1/4" MIN. EDGE DISTANCE (G=0.42 MIN)	21	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	10.0"
		31	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		41	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		51	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		60	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		60	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
	1/4"-20 PANELMATE INSERT WITH 1-5/8" EMBED AND 3/4" MIN. EDGE DISTANCE (G=0.42 MIN.)	21	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	11.5"
		31	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		41	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		51	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		60	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		60	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
	1/4" WOOD OR LAG SCREW WITH 1-3/8" MIN THREAD PEN. AND 3/4" MIN. EDGE DISTANCE (G=0.42 MIN.)	21	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	9.5"
		31	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		41	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		51	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		60	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	
		60	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"	

ANCHOR NOTES:


- ANCHOR SCHEDULE APPLIES TO ALL PRODUCTS CERTIFIED HEREIN, BUT ONLY PROVIDES MAXIMUM ALLOWABLE ANCHOR SPACING. MAXIMUM ALLOWABLE SPANS AND PRESSURES INDICATED IN SPAN SCHEDULE SHALL APPLY.
- ENTER ANCHOR SCHEDULE BASED ON PANEL FASTENER SPACING, THE EXISTING STRUCTURE MATERIAL, & ANCHOR TYPE. SELECT DESIGN LOAD GREATER THAN OR EQUAL TO NEGATIVE DESIGN LOAD ON SHUTTER AND SELECT SPAN GREATER THAN OR EQUAL TO SHUTTER SPAN. SELECT CONNECTION TYPE BASED ON APPROPRIATE MOUNTING CONDITION (SEE MOUNTING DETAILS ON SHEET 3 FOR IDENTIFICATION OF CONNECTION TYPE).
- "PANEL FASTENERS" ARE STUDS USED IN CONJUNCTION WITH ALL MOUNTING EXTRUSIONS ("F"-TRACK, STUDDING ANGLE, ETC.). "PANEL FASTENERS" SHALL BE SPACED AT 12" O.C. ALL END PANEL HOLES SHALL HAVE PANEL FASTENERS, TYP.
- ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS' RECOMMENDATIONS.
- HOLLOW BLOCK HOST STRUCTURE SHALL CONFORM TO ASTM C90 BLOCK.
- MINIMUM EMBEDMENT SHALL BE AS NOTED IN ANCHOR SCHEDULE.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDES STUCCO, FOAM, BRICK, AND OTHER WALL FINISHES. WALL FINISHES SHALL BE LIMITED TO 1/4" MAX OR SHALL BE VERIFIED BY OTHERS TO ADEQUATELY TRANSFER LOADS TO HOST STRUCTURE.
- CONCRETE ANCHORS NOTED HEREIN SHALL BE EMBEDDED TO UN-CRACKED CONCRETE ONLY.
- WHERE EXISTING STRUCTURE IS WOOD FRAMING, EXISTING CONDITIONS MAY VARY. FIELD VERIFY THAT FASTENERS ARE INTO ADEQUATE WOOD FRAMING MEMBERS, NOT PLYWOOD. FASTENING TO PLYWOOD IS ACCEPTABLE ONLY FOR SIDE CLOSURE PIECES.
- WHERE ANCHORS FASTEN TO NARROW FACE OF STUD FRAMING, FASTENER SHALL BE LOCATED IN CENTER OF NOMINAL 2" X 4" (MIN.) WOOD STUD (3/4" EDGE DISTANCE IS ACCEPTABLE FOR WOOD FRAMING). WOOD STUD SHALL BE G=0.42 OR GREATER DENSITY, U.N.O. LAG SCREWS SHALL HAVE PHILLIPS PAN HEAD OR HEX HEAD.
- REMOVABLE ANCHORS ARE: ELCO PANELMATE, ALL-POINTS SOLID-SET.
- MACHINE SCREWS SHALL HAVE 1/2" MINIMUM ENGAGEMENT OF THREADS INTO THE BASE ANCHOR AND MAY HAVE EITHER A PAN HEAD, TRUSS HEAD, OR WAFER HEAD (SIDEWALK BOLT) U.N.O.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDES STUCCO OR OTHER WALL FINISHES.
- (ZZ) DESIGNATES ANCHOR CONDITIONS WHICH ARE NOT ACCEPTABLE USES.
- * DIRECT MOUNTING CONDITIONS.
- LINEAR INTERPOLATION IS NOT PERMITTED FOR USE WITH THE ANCHOR SCHEDULES LISTED ON THIS SHEET.
- PROVIDE KEYHOLE WASHER FOR 1/4"-20 SIDEWALK BOLTS (OR TRUSS HEAD SCREWS)








ENGINEERING EXPRESS
CORPORATE OFFICE
160 SW 12th AVE., SUITE 106
DEERFIELD BEACH, FL 33442
P: (561) 354-0660 F: (561) 354-0663
E: HERNANDEZ@ENGINEERINGEXPRESS.COM
ENGINEER RENALDO J. HERNANDEZ
CERT. OF AUTH. #2883

ANCHOR SPACING (FOR SCHEDULE 2 - NON-HVHZ ONLY):

2" CLEAR PANELS


HOST STRUCT.	ANCHOR	LOAD (psf)	EDGE DISTANCES AS NOTED					
			Spans Up To 3'-0"		Spans Up To 7'-0"		Spans Up To 12'-0"	
			C1	C2	C1	C2	C1	C2
CONCRETE	1/4" ITW TAPCON WITH 1-3/4" EMBED AND 1-1/2" MIN. EDGE DISTANCE (3192 psi MIN CONCRETE)	35	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		40	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		45	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		50	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		55	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		60	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
	1/4" ELCO ULTRACON WITH 1-3/4" EMBED AND 1" MIN. EDGE DISTANCE (2846 psi MIN CONCRETE)	35	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		40	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		45	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		50	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		55	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		60	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
WOOD	1/4" ELCO PANELMATE (FEMALE, MALE, OR PLUS) W/ 2" EMBED AND 2-1/2" MIN. EDGE DISTANCE (3350 psi MIN CONCRETE)	35	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		40	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		45	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		50	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		55	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		60	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
	1/4" ITW TAPCON STORM GAURD W/ 1-3/4" EMBED AND 1-1/4" MIN. EDGE DISTANCE (3295 psi MIN CONCRETE)	35	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		40	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		45	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		50	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		55	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		60	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
WOOD	1/4"-20 ALL POINTS SOLID-SET WITH 7/8" EMBED AND 1-1/4" MIN. EDGE DISTANCE (3000 psi MIN CONCRETE)	35	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		40	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		45	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		50	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		55	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		60	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"

HOST STRUCT.	ANCHOR	LOAD (psf)	EDGE DISTANCES AS NOTED					
			Spans Up To 3'-0"		Spans Up To 7'-0"		Spans Up To 12'-0"	
			C1	C2	C1	C2	C1	C2
HOLLOW (OR GROUT-FILLED) BLOCK	1/4" ITW TAPCON WITH 1" EMBED AND 2" MIN. EDGE DISTANCE (1900 psi MIN CMU)	35	12.0"	12.0"	6.0"	11.5"	6.0"	6.0"
		40	12.0"	12.0"	6.0"	10.0"	6.0"	6.0"
		45	12.0"	12.0"	6.0"	9.0"	6.0"	6.0"
		50	12.0"	12.0"	6.0"	8.0"	6.0"	6.0"
		55	12.0"	12.0"	6.0"	7.0"	6.0"	6.0"
		60	12.0"	12.0"	6.0"	6.0"	6.0"	6.0"
	1/4" ELCO ULTRACON WITH 1-1/4" EMBED AND 1" MIN. EDGE DISTANCE (1900 psi MIN CMU)	35	12.0"	12.0"	12.0"	12.0"	6.0"	7.0"
		40	12.0"	12.0"	12.0"	12.0"	6.0"	7.0"
		45	12.0"	12.0"	12.0"	10.5"	6.0"	7.0"
		50	12.0"	12.0"	12.0"	9.5"	6.0"	7.0"
		55	12.0"	12.0"	12.0"	8.5"	6.0"	7.0"
		60	12.0"	12.0"	12.0"	7.0"	6.0"	7.0"
HOLLOW (OR GROUT-FILLED) BLOCK	1/4" ELCO PANELMATE (FEMALE, MALE, OR PLUS) W/ 1-1/4" EMBED AND 2" MIN. EDGE DISTANCE (2000 psi MIN CMU)	35	12.0"	12.0"	12.0"	12.0"	12.0"	11.0"
		40	12.0"	12.0"	12.0"	12.0"	12.0"	11.0"
		45	12.0"	12.0"	12.0"	12.0"	12.0"	11.0"
		50	12.0"	12.0"	12.0"	12.0"	12.0"	11.0"
		55	12.0"	12.0"	12.0"	12.0"	12.0"	11.0"
		60	12.0"	12.0"	12.0"	11.0"	12.0"	11.0"
	1/4"-20 ALL POINTS SOLID-SET WITH 7/8" EMBED AND 1-1/4" MIN. EDGE DISTANCE (1800 psi MIN CMU)	35	12.0"	12.0"	12.0"	12.0"	6.0"	8.5"
		40	12.0"	12.0"	12.0"	12.0"	6.0"	8.5"
		45	12.0"	12.0"	12.0"	12.0"	6.0"	8.5"
		50	12.0"	12.0"	12.0"	11.0"	6.0"	8.5"
		55	12.0"	12.0"	12.0"	10.0"	6.0"	8.5"
		60	12.0"	12.0"	12.0"	8.5"	6.0"	8.5"

HOST STRUCT.	ANCHOR	LOAD (psf)	EDGE DISTANCES AS NOTED					
			Spans Up To 3'-0"		Spans Up To 7'-0"		Spans Up To 12'-0"	
			C1	C2	C1	C2	C1	C2
WOOD	1/4" ITW TAPCON WITH 1-3/8" THREAD PEN. AND 3/4" MIN. EDGE DISTANCE (G=0.42 MIN)	35	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		40	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		45	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		50	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		55	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		60	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
	1/4" ELCO ULTRACON WITH 1-3/8" THREAD PEN. AND 3/4" MIN. EDGE DISTANCE (G=0.42 MIN)	35	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		40	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		45	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		50	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		55	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		60	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
WOOD	1/4" ELCO PANELMATE (FEMALE, MALE, OR PLUS) W/ 1-7/8" EMBED AND 3/4" MIN. EDGE DISTANCE (G=0.54 MIN.)	35	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		40	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		45	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		50	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		55	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		60	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
	1/4" ITW TAPCON STORM GAURD W/ 1-3/4" EMBED AND 1-1/4" MIN. EDGE DISTANCE (G=0.42 MIN)	35	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		40	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		45	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		50	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		55	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
		60	12.0"	12.0"	12.0"	12.0"	12.0"	12.0"
WOOD	1/4"-20 PANELMATE INSERT WITH 1-5/8" EMBED AND 3/4" MIN. EDGE DISTANCE (G=0.42 MIN.)	35	12.0"	12.0"	12.0"	12.0"	12.0"	11.5"
		40	12.0"	12.0"	12.0"	12.0"	12.0"	11.5"
		45	12.0"	12.0"	12.0"	12.0"	12.0"	11.5"
		50	12.0"	12.0"	12.0"	12.0"	12.0"	11.5"
		55	12.0"	12.0"	12.0"	12.0"	12.0"	11.5"
		60	12.0"	12.0"	12.0"	12.0"	12.0"	11.5"
	1/4" WOOD OR LAG SCREW WITH 1-3/8" MIN THREAD PEN. AND 3/4" MIN. EDGE DISTANCE (G=0.42 MIN.)	35	12.0"	12.0"	12.0"	12.0"	12.0"	11.5"
		40	12.0"	12.0"	12.0"	12.0"	12.0"	11.5"
		45	12.0"	12.0"	12.0"	12.0"	12.0"	11.5"
		50	12.0"	12.0"	12.0"	12.0"	12.0"	11.5"
		55	12.0"	12.0"	12.0"	12.0"	12.0"	11.5"
		60	12.0"	12.0"	12.0"	12.0"	12.0"	11.5"

ANCHOR NOTES:

- ANCHOR SCHEDULE APPLIES TO ALL PRODUCTS CERTIFIED HEREIN, BUT ONLY PROVIDES MAXIMUM ALLOWABLE ANCHOR SPACING. MAXIMUM ALLOWABLE SPANS AND PRESSURES INDICATED IN SPAN SCHEDULE SHALL APPLY.
- ENTER ANCHOR SCHEDULE BASED ON PANEL FASTENER SPACING, THE EXISTING STRUCTURE MATERIAL, & ANCHOR TYPE. SELECT DESIGN LOAD GREATER THAN OR EQUAL TO NEGATIVE DESIGN LOAD ON SHUTTER AND SELECT SPAN GREATER THAN OR EQUAL TO SHUTTER SPAN. THIS SHEET APPLIES TO CONNECTION TYPE "C1" AND "C2" ONLY (SEE MOUNTING DETAILS ON SHEET 3 FOR IDENTIFICATION OF CONNECTION TYPE). "H" HEADER AND "U" HEADER OPTIONS ARE NOT APPLICABLE FOR THESE TABLES.
- ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS' RECOMMENDATIONS.
- HOLLOW BLOCK HOST STRUCTURE SHALL CONFORM TO ASTM C90 BLOCK.
- MINIMUM EMBEDMENT SHALL BE AS NOTED IN ANCHOR SCHEDULE.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDES STUCCO, FOAM, BRICK, AND OTHER WALL FINISHES. WALL FINISHES SHALL BE LIMITED TO 1/4" MAX OR SHALL BE VERIFIED BY OTHERS TO ADEQUATELY TRANSFER LOADS TO HOST STRUCTURE.
- CONCRETE ANCHORS NOTED HEREIN SHALL BE EMBEDDED TO UN-CRACKED CONCRETE ONLY.
- WHERE EXISTING STRUCTURE IS WOOD FRAMING, EXISTING CONDITIONS MAY VARY. FIELD VERIFY THAT FASTENERS ARE INTO ADEQUATE WOOD FRAMING MEMBERS, NOT PLYWOOD. FASTENING TO PLYWOOD IS ACCEPTABLE ONLY FOR SIDE CLOSURE PIECES.
- WHERE ANCHORS FASTEN TO NARROW FACE OF STUD FRAMING, FASTENER SHALL BE LOCATED IN CENTER OF NOMINAL 2" x 4" (MIN.) WOOD STUD (3/4" EDGE DISTANCE IS ACCEPTABLE FOR WOOD FRAMING). WOOD STUD SHALL BE G=0.42 OR GREATER DENSITY, U.N.O. LAG SCREWS SHALL HAVE PHILLIPS PAN HEAD OR HEX HEAD.
- REMOVABLE ANCHORS ARE: ELCO PANELMATE, ALL-POINTS SOLID-SET.
- MACHINE SCREWS SHALL HAVE 1/2" MINIMUM ENGAGEMENT OF THREADS INTO THE BASE ANCHOR AND MAY HAVE EITHER A PAN HEAD, TRUSS HEAD, OR WAFER HEAD (SIDEWALK BOLT) U.N.O.
- MINIMUM EMBEDMENT AND EDGE DISTANCE EXCLUDES STUCCO OR OTHER WALL FINISHES.
- (C2) DESIGNATES ANCHOR CONDITIONS WHICH ARE NOT ACCEPTABLE USES.
- * DIRECT MOUNTING CONDITIONS.
- LINEAR INTERPOLATION IS NOT PERMITTED FOR USE WITH THE ANCHOR SCHEDULES LISTED ON THIS SHEET.
- PROVIDE KEYHOLE WASHER FOR 1/4"-20 SIDEWALK BOLTS

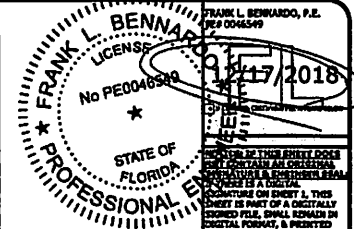

ENGINEERING EXPRESS
CORPORATE OFFICE:
160 SW 12th AVE, SUITE 106
DEERFIELD BEACH, FL 33442
P: (888) 334-4400 F: (888) 334-4400
E: HELL@ENGINEERINGEXPRESS.COM
ENGINEERING EXPRESS, INC.
CERT. OF AUTH. #8835

EASTERN METAL SUPPLY
4269 WESTROADS DR
WEST PALM BEACH, FL
(800) 432-2204
2" CLEAR BERTHA STORM PANEL
FLORIDA BUILDING CODE
FLORIDA STATEWIDE APPROVAL FL28390-3

REVISION	DATE	BY	CHKD	DATE	BY	CHKD
1	11/17/2018	FLB	FLB			

COPYRIGHT ENGINEERING EXPRESS, INC.
18-6492
SCALE: NTS UNLESS NOTED
5